


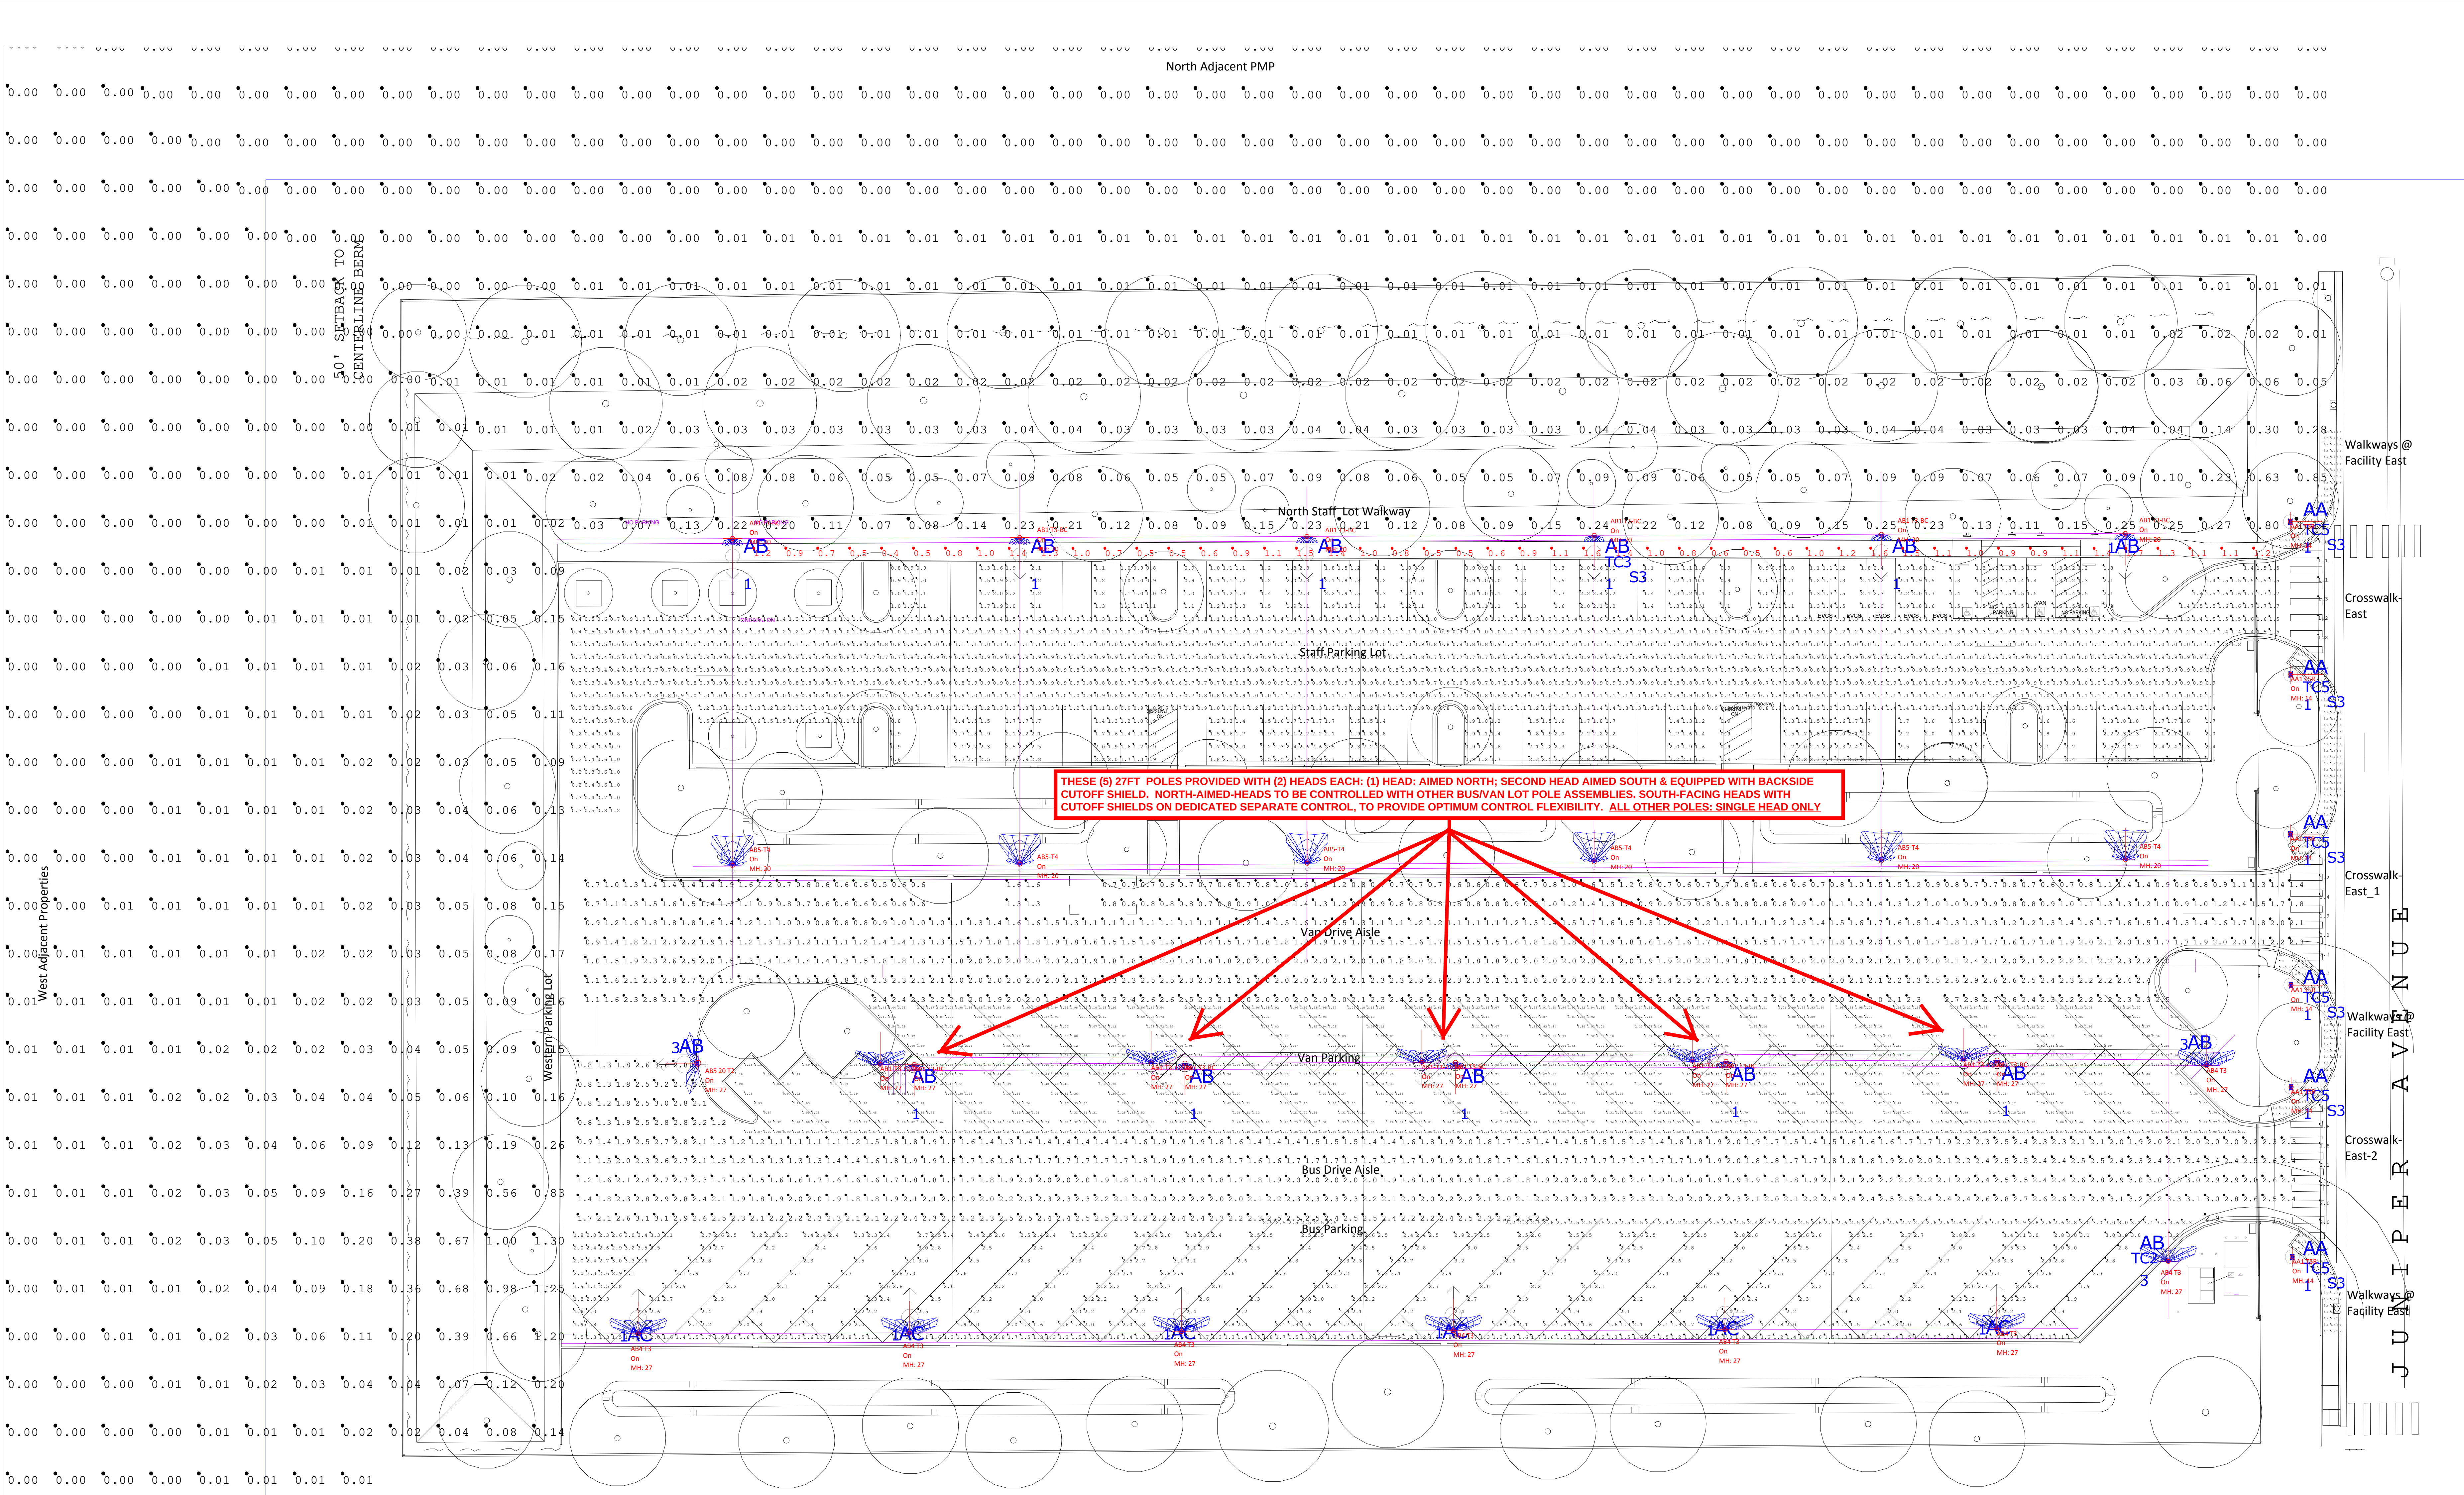

Luminaire Schedule							
Symbol	Tag	Qty	Label	Arrangement	Total Lamp Lumens	LLF	Description
	AB1-T3-110W	5	UR20-56L-110-3K7-3-PT	Single	N.A.	0.750	UR20-56L-110-3K7-3-PT
	AB5-T4	6	UR20-56L-110-4K7-4-PT	Single	N.A.	0.750	UR20-56L-110-4K7-4-PT
	AB1 T3-BC	11	UR20-56L-75-3K7-3-BC-PT	Single	N.A.	0.750	UR20-56L-75-3K7-3-BC-PT
	AA1 T5R	6	UR20-24L-25-3K7-5R-PT	Single	N.A.	0.750	UR20-24L-25-3K7-5R-PT
	AB4 T3	8	UR20-56L-140-3K7-3-PT	Single	N.A.	0.750	UR20-56L-140-3K7-3-PT
	AB5 20 T2	1	UR20-56L-140-3K7-2-PT	Single	N.A.	0.750	UR20-56L-140-3K7-2-PT

LPD Area Summary			
Label	Area	Total Watts	LPD

Calculation Summary									
Label	CalcType	Units	Avg	Max	Min	Max/Min			
Bus Drive Aisle	Illuminance	Fc	2.04	3.6	0.8	4.50			
Bus Parking	Illuminance	Fc	2.24	3.6	1.0	3.60			
Crosswalk-East	Illuminance	Fc	1.15	1.3	1.0	1.30			
Crosswalk-East_1	Illuminance	Fc	1.71	2.2	1.1	2.00			
Crosswalk-East_2	Illuminance	Fc	1.91	2.1	1.6	1.31			
North Staff Lot Walkway	Illuminance	Fc	0.98	1.7	0.4	4.25			
STAFF PARKING LOT	Illuminance	Fc	1.19	2.9	0.2	14.50			
Van Drive Aisle	Illuminance	Fc	1.60	3.1	0.5	6.20			
Van Parking	Illuminance	Fc	1.74	2.95	0.87	3.39			
Walkways @ Facility East	Illuminance	Fc	1.43	2.8	0.4	7.00			
zed	Illuminance	Fc	0.02	1.14	0.00	N.A.			
zedd	Illuminance	Fc	0.03	1.30	0.00	N.A.			